



COPING TRANSITION MITERS

90° MITERS

OUTSIDE MITER

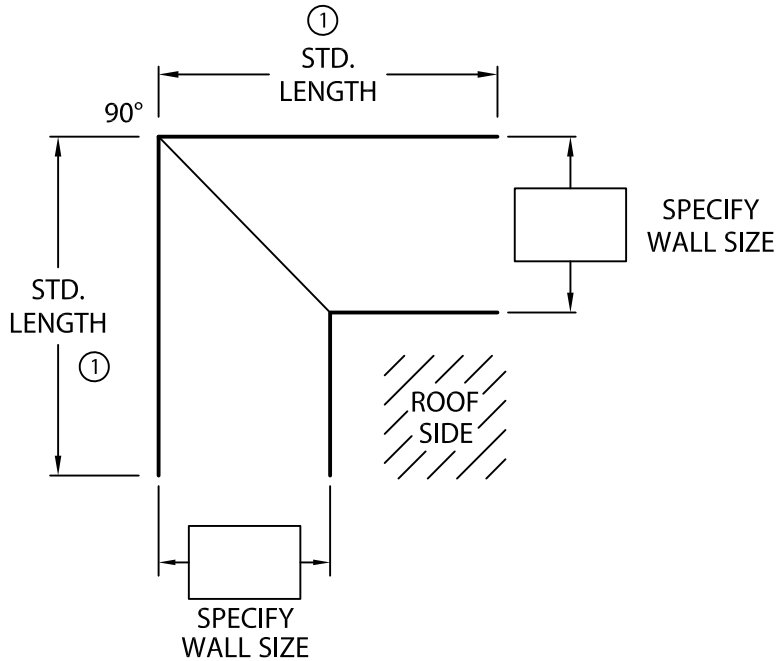


INSIDE MITER

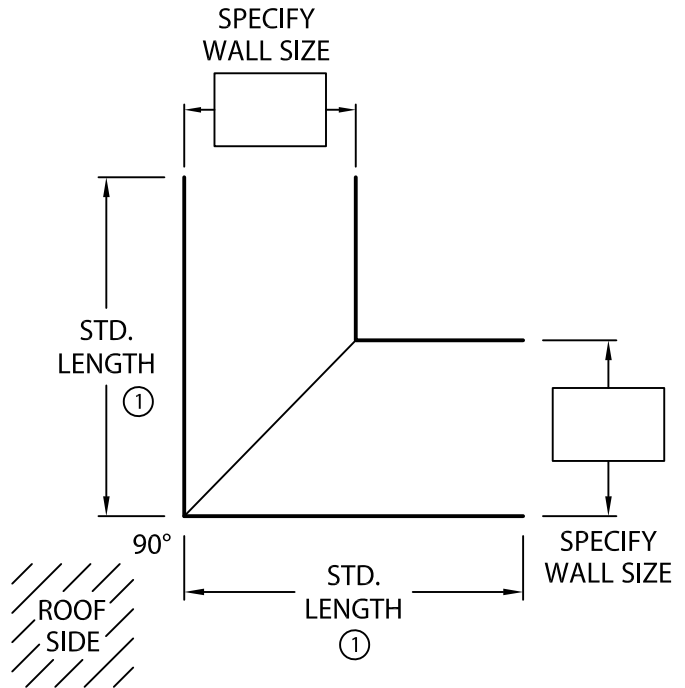

FOR CUSTOM LEG LENGTHS MODIFY DRAWINGS ABOVE

NOTES:

- ① THE STANDARD LEG LENGTH FOR COPING WITH A DRIP IS THE LARGER WALL SIZE + $9\frac{5}{8}$ ".
THE STANDARD LEG LENGTH FOR COPING WITH A FLUSH FACE IS THE LARGER WALL SIZE + $10\frac{1}{8}$ ".

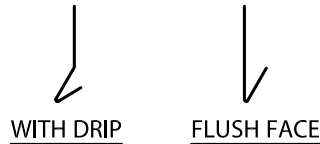

- ② WELDED ACCESSORIES REQUIRE A MINIMUM MATERIAL THICKNESS OF .050".

AUTHORIZED SIGNATURE:

APPROVED BY: _____

DATE: _____

MATERIAL:

☐ 24 GA. GALVANIZED STEEL
☐ 22 GA. GALVANIZED STEEL
☐ .040" ALUMINUM
☐ .050" ALUMINUM
☐ .063" ALUMINUM
☐ OTHER _____

COLOR: _____

FINISH: _____

QUANTITIES:

_____ OUTSIDE MITERS @ 90°

_____ INSIDE MITERS @ 90°

SPECIFY ACCESSORY TYPE:

- ☐ WELDED ②
☐ QUICKLOCK

FOR NON-90 MITERS SEE PRINT APPROVAL #60010-29179

PROJECT:

ARCHITECT:

ROOFING CONTRACTOR:

REPRESENTATIVE/DISTRIBUTOR:

TREMCO ROOFING AND BUILDING MAINTENANCE
 3735 GREEN RD; BEACHWOOD, OH 44122
 PHONE: 262-953-2666
 EDGESYSTEMS@TREMCOINC.COM
 WWW.TREMCOROOFING.COM

TREMCO
ROOFING & BUILDING MAINTENANCE

DATE: 07/21/18

DRN BY: JJC

CKD BY: SAK

SHT.# _____ OF _____

DWG# 60011-29300

A